


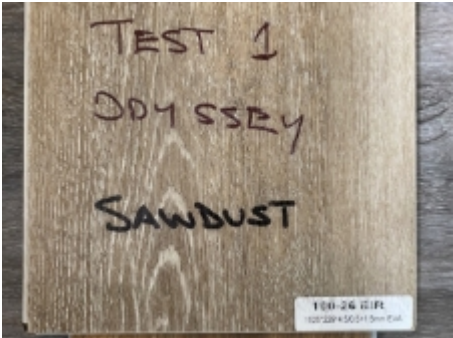
Artistic Flooring - ODYSSEY HYBRID FLOORING #1 - Wet Sliptest KO161220-3

17 Dec 2020

Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	16 Dec 2020
Test Report Number:	KO161220-3
Client Name & Address:	Artistic Flooring - 6/98 Ingleston Road WAKERLEY QLD 4154
Test Site / Surface Tested :	ODYSSEY HYBRID FLOORING #1
Sample Information :	Samples and Test Information Supplied by Client
Wet Pendulum Test carried out using :	Slider 96 (4S) Rubber slider
Any Variations to Standards	Variation to Standards at Clients request
Testing Officer / Approved Signatory:	Kathryn Ording
Pendulum in use - Calibration Date :	#2047 - 02.09.2020 - Munro-Stanley Portable Skid Tester
Signature of Approved Signatory :	

Test Results :

Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	SCV :	Surface Picture
Plank 1A	42	42	42	42	42	42	N/A	
Plank 1B	43	43	43	43	43	43	N/A	
Plank 2A	36	35	35	35	35	35	N/A	
Plank 2B	36	36	35	35	35	35	N/A	
Plank 3A	36	35	35	35	35	35	N/A	

Variation to Standard Mean BPN Slip Resistance Value (SRV) 38

CLASSIFICATION using Slider 96 (4S Slider) P3 = 35 - 44

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A - Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results do not account for Future Wear, Maintenance or Contamination of this surface once in-situ.

Page 1 of 1 - END OF REPORT

